



TOWN OF OCEAN RIDGE

6450 North Ocean Boulevard, Ocean Ridge, Florida 33435
(561) 732-2635 Main ♦ (561) 737-8359 Fax
oceanridgeflorida.com ♦ permit@oceanridgeflorida.com

Acknowledgement of Driveway Swale Detail

This form acknowledges receipt of the Driveway Swale Detail which I must abide by in performing the work described in the below stated permit number.

Permit Number

Date


Property Owner's Signature

Property Owner's Printed Name

Date

Qualifier/Contractor's Signature

Qualifier/Contractor's Printed Name

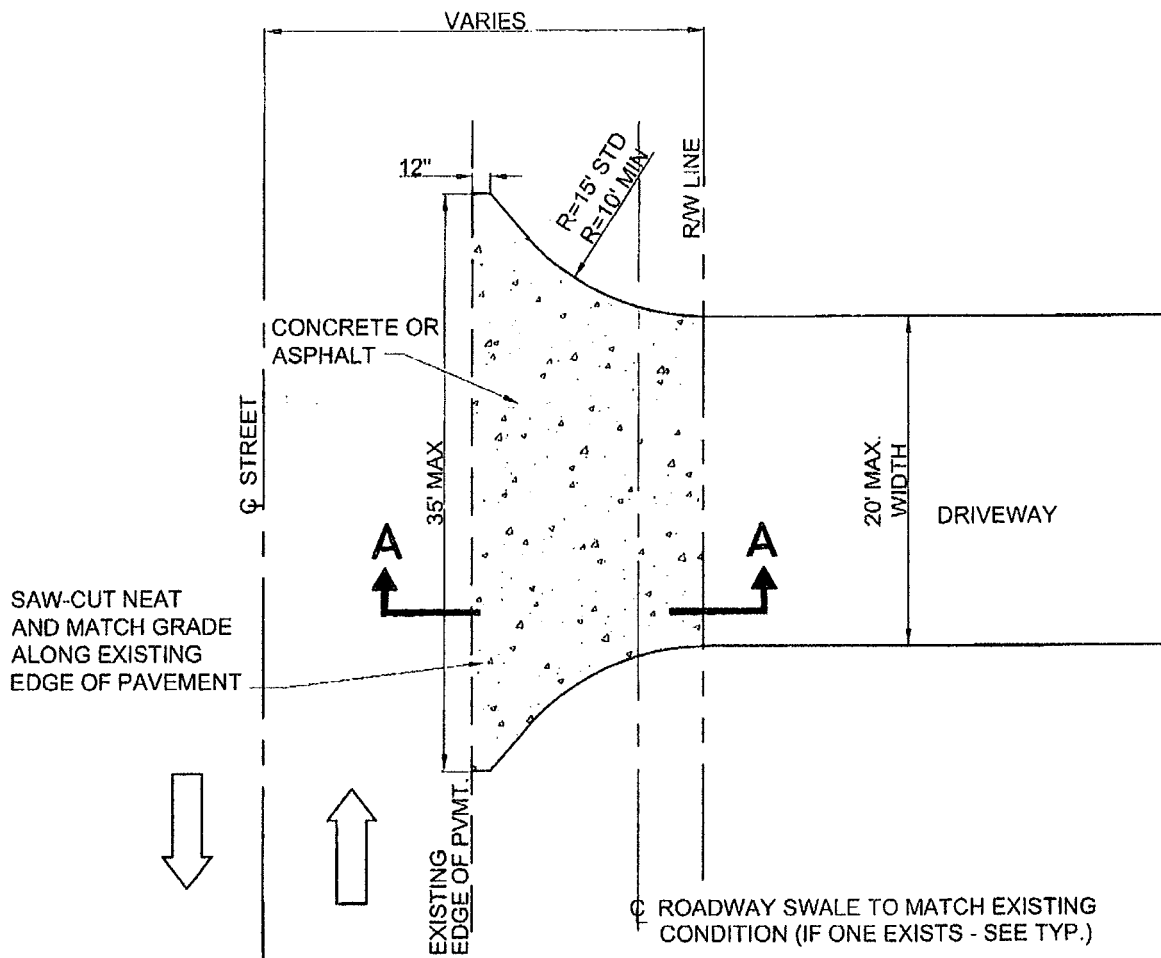

RESIDENTIAL DRIVEWAY TURNOUT PLAN VIEW

NOTE: DETAIL FOR TOWN
RIGHT-OF-WAY ONLY

© COPYRIGHT 2009 - ENGENUITY GROUP, INC.

TOWN OF OCEAN RIDGE

DATE:	12-8-09
PROJECT ENGINEER:	LMC
CHECKED BY:	MRH
CHECKED BY:	<i>[Signature]</i>


A Higher Standard of Excellence

engenuity
group inc.

ENGINEERS • SURVEYORS • GIS MAPPERS

1201 BELVEDERE ROAD, WEST PALM BEACH, FLORIDA 33408
PH (561) 858-1151 • FAX (561) 832-8300 • WWW.ENGENUITYGROUP.COM

SCALE:	N.T.S.	SHEET:	1 / 2
DRAWN BY:	LMC	JOB No.	00020.10

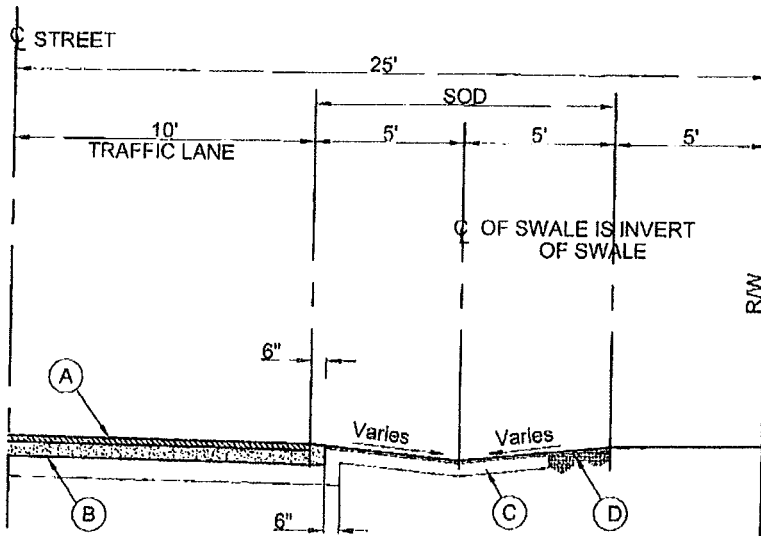

NOTES

- (A) 1 1/2" THICK, TYPE S-I, ASPHALTIC CONCRETE SURFACE COURSE.
- (B) BASE SHALL BE 8" MINIMUM THICKNESS. ALL NEW BASE MATERIAL SHALL BE 16" OF LIMEROCK OR 8" LIMEROCK BASE OVER 12" OF STABILIZED SUBGRADE.
- (C) STABILIZED SHOULDER IS 8' WIDE AND 6" THICK. STABILIZE TO A FLORIDA BEARING VALUE OF AT LEAST 50 P.S.I. AND COMPACT TO AT LEAST 98% OF THE MAXIMUM DENSITY DETERMINED BY A.A.S.H.T.O. T-180.
- (D) SWALE IS TO BE GRASSED WITH BAHIA SOD. JOINTS ARE TO BE LAPPED AND ROLLED TO INSURE COMPLETE AND UNIFORM COVERAGE.
- (E) WHERE DRIVEWAYS INTERSECT SWALES, DRIVEWAYS SHALL CONFORM TO THE SWALE SECTION.

TYPICAL SWALE AND STREET CROSS SECTION


50' R/W

© COPYRIGHT 2009 - ENGENUITY GROUP, INC.

TOWN OF OCEAN RIDGE


DATE:	12-8-09
PROJECT ENGINEER:	LMC
CHECKED BY:	MRH
CHECKED BY:	<i>[Signature]</i>

A Higher Standard of Excellence

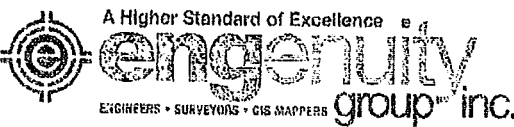


1201 BELVEDERE ROAD, WEST PALM BEACH, FLORIDA 33405
PH (561)866-1151 • FAX (561)832-9380 • WWW.ENGENUITYGROUP.COM

SCALE:	N.T.S.	SHEET:	1 / 1
DRAWN BY:	LMC	JOB No.	00020.10

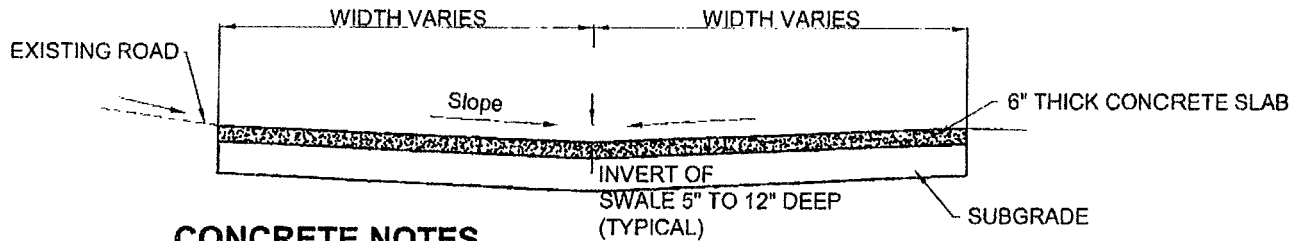

CONCRETE NOTES

- (1) SUBGRADE SHALL BE THOROUGHLY COMPACTED BY MECHANICAL TAMP TO AT LEAST 98% OF THE MAXIMUM DENSITY PER A.A.S.H.T.O. T-180.
- (2) SEE PLAN FOR SLOPE AND WIDTH INFORMATION.
- (3) SEE SWALE AND STREET CROSS SECTION FOR SWALE INFORMATION.

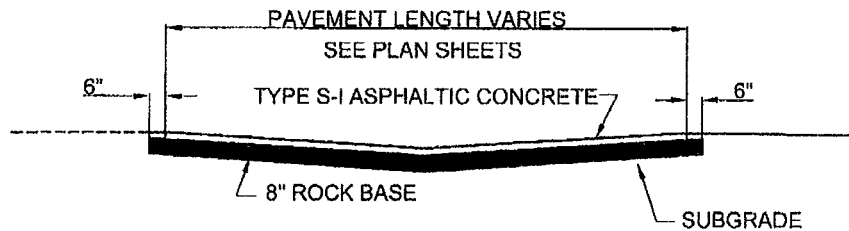

ASPHALT NOTES

- (1) BASE MATERIAL SHALL BE THOROUGHLY COMPACTED BY MECHANICAL TAMP IN LIFTS NOT TO EXCEED 4" THICKNESS. COMPACT TO AT LEAST 98% MAXIMUM DENSITY PER A.A.S.H.T.O. T-180.
- (2) THE BASE SHALL BE PRIMED WITH A BITUMINOUS PRIME COAT PRIOR TO PAVING.
- (3) REPLACEMENT WEARING SURFACE MATERIAL WILL MATCH EXISTING SURFACE. MINIMUM STANDARD OF REPLACEMENT WILL BE 1 1/2" THICK TYPE S-I ASPHALTIC CONCRETE.
- (4) ROCK BASE SHALL HAVE A MINIMUM LBR OF 100.
- (5) COMPACT SUBGRADE TO AT LEAST 98% OF THE MAXIMUM DENSITY DETERMINED BY A.A.S.H.T.O. T-180.

SECTION A-A


N.T.S.

© COPYRIGHT 2009 – ENGENUITY GROUP, INC.

TOWN OF OCEAN RIDGE

DATE:	12-8-09
PROJECT ENGINEER:	LMC
CHECKED BY:	MRH
CHECKED BY:	<i>[Signature]</i>

A Higher Standard of Excellence



engenuity
group inc.

ENGINEERS • SURVEYORS • GIS MAPPERS

1201 BELVEDERE ROAD, WEST PALM BEACH, FLORIDA 33405
PH (561)855-1151 • FAX (561)832-8380 • WWW.ENGENUITYGROUP.COM

SCALE:	N.T.S.	SHEET:	2 / 2
DRAWN BY:	LMC	JOB No.	00020.10